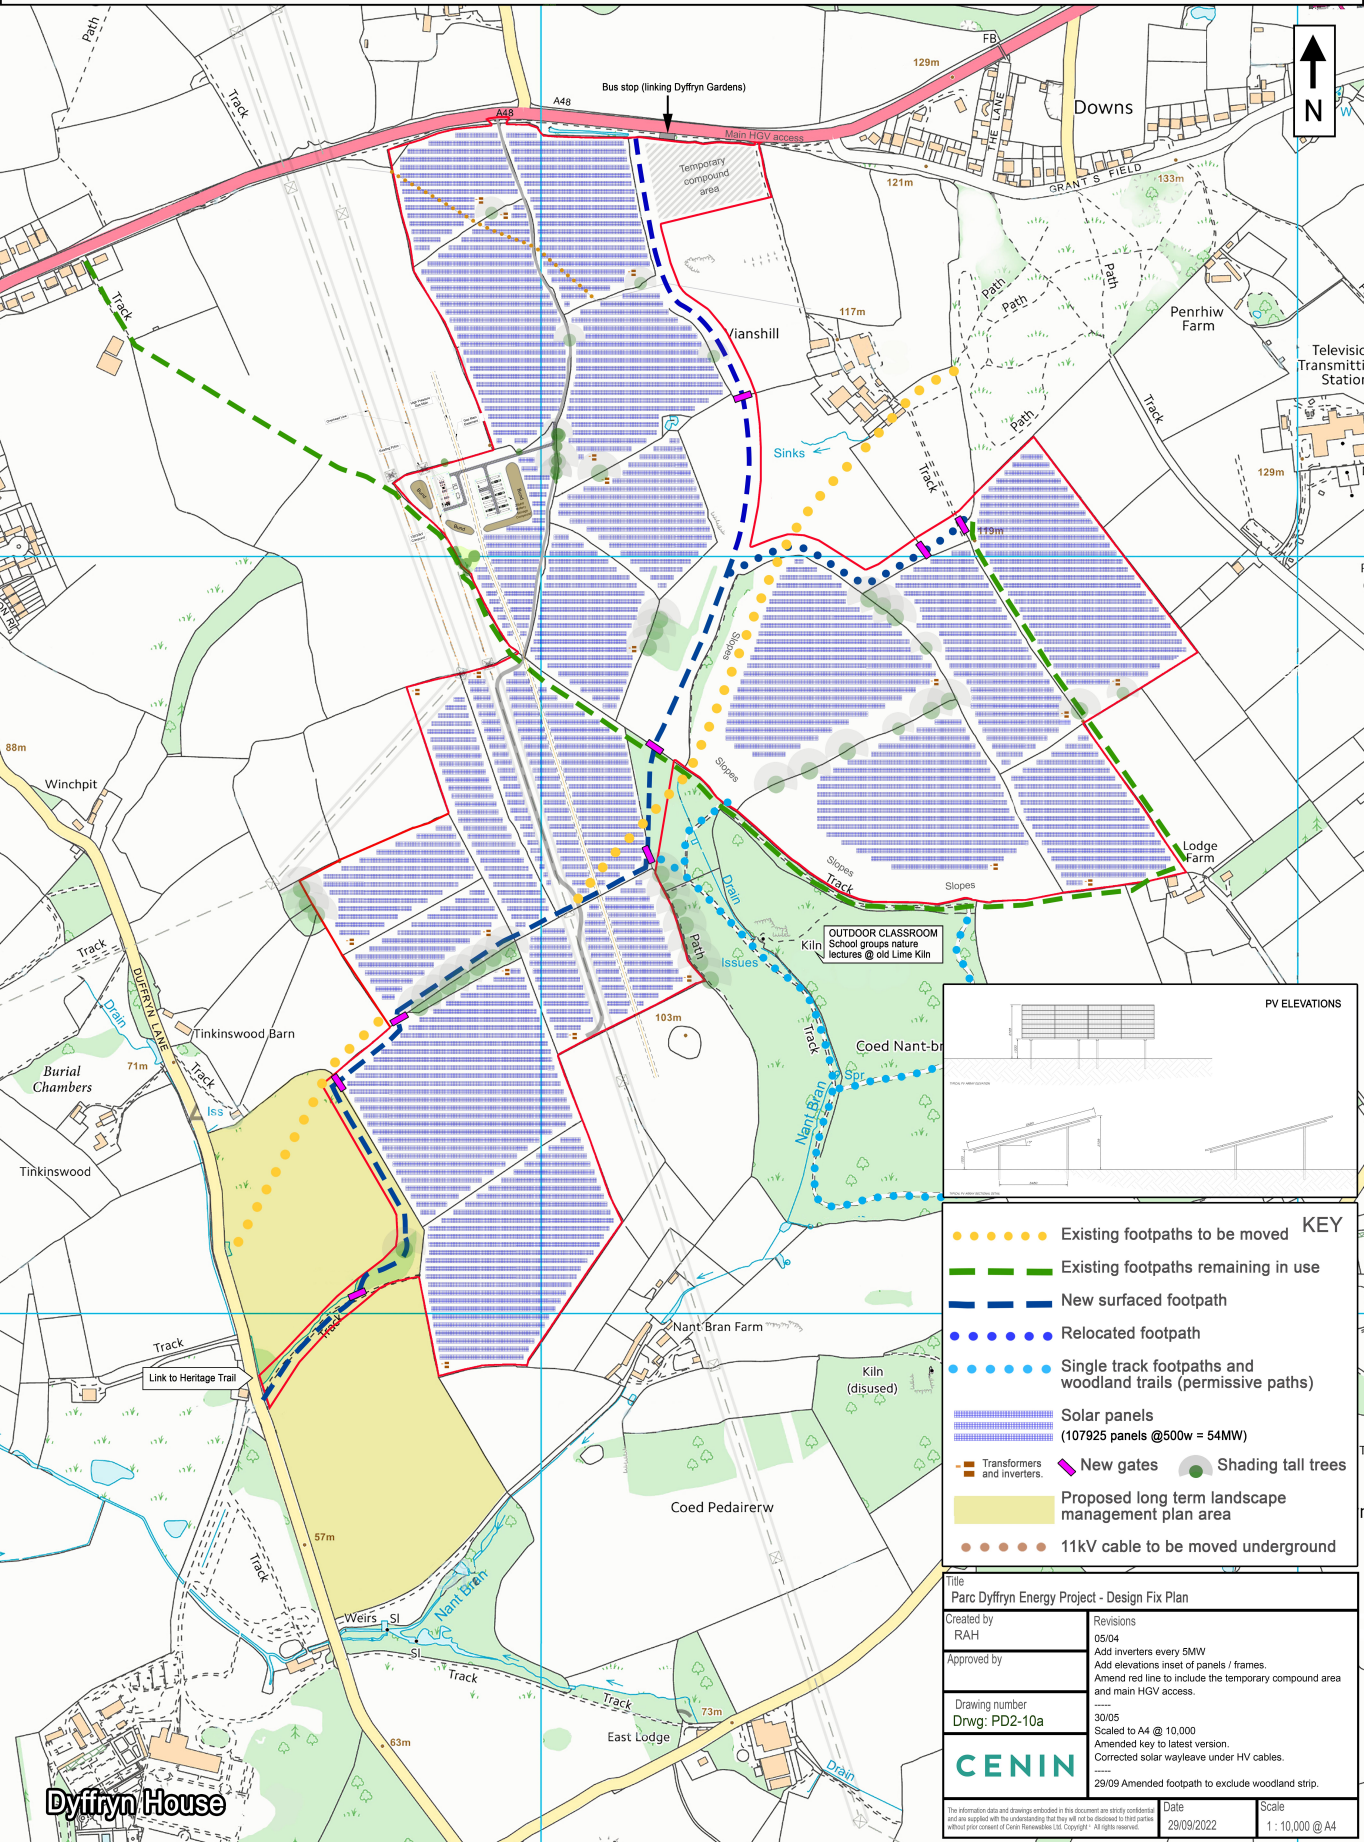


- KEY**
- Existing footpaths to be moved
 - Existing footpaths remaining in use
 - New surfaced footpath
 - Relocated footpath
 - Single track footpaths and woodland trails (permissive paths)
 - Solar panels (107925 panels @500w = 54MW)
 - Transformers and inverters
 - New gates
 - Shading tall trees
 - Proposed long term landscape management plan area
 - 11kV cable to be moved underground

Title Parc Dyffryn Energy Project - Design Fix Plan	
Created by RAH	Revisions 05/04
Approved by	Add inverters every 5MW Add elevations inset of panels / frames. Amend red line to include the temporary compound area and main HGV access.
Drawing number Drwg: PD2-10a	30/05 Scaled to A4 @ 10,000 Amended key to latest version. Corrected solar wayleave under HV cables. 29/09 Amended footpath to exclude woodland strip.